


1 PIPING - 1


| REVISION | AMENDMENT | APPROVED | REVISION | | | | | | |
|----------|-----------------------|----------|----------|---|-----|--------|----------|--------|----|
| A | ISSUED FOR 95% REVIEW | DC | 08/03/22 | | | | | | |
| | | | | | | | | | |
| | | | | 0 | 10 | 20 | | 40 | |
| | | | | - | - 6 |) (A1) | 1:1, (| l3) 1: | 2 |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | DO | NOT SO | CALE OFF | DRAW | iN |
| | | | | | | | | | |



| | 4 |
|---|---|
| | TRILITY PTY LTD 27 COMMERCE CIRCUIT, YATALA, QLD 4207 |
| | TEL: +61 7 3208 9500 www.trility.com.au |
| TRILITY TRILITY PTY LTD COPYRIGHT. P | |
| APPROVAL TO MODIFY OR CO APPROVED VIA TO | PY THIS DRAWING MUST BE RILITY PTY LTD. |

| | DC DRAWN BY | MG DRN CHK | CENTRAL HAWKE'S BAY COUNCIL | ISSUED F | ISSUED FOR 95% REVIEW | | |
|----------|--------------------------------|---------------|---|----------------------|-----------------------|------|----|
| | JAD DRAWN DATE08/03/22 | MB | KAIRAKAU WATER SUPPLY UPGRADE WATER TREATMENT PLANT | AS | SITE ID | AREA | A1 |
| A | APPROVED BY DC APPROVED DATE | | SITE LAYOUT - OVERVIEW | S-0148-C-DWG-001-001 | | | A |
| 08/03/22 | | | SHEET 1 OF 7 | | | | |

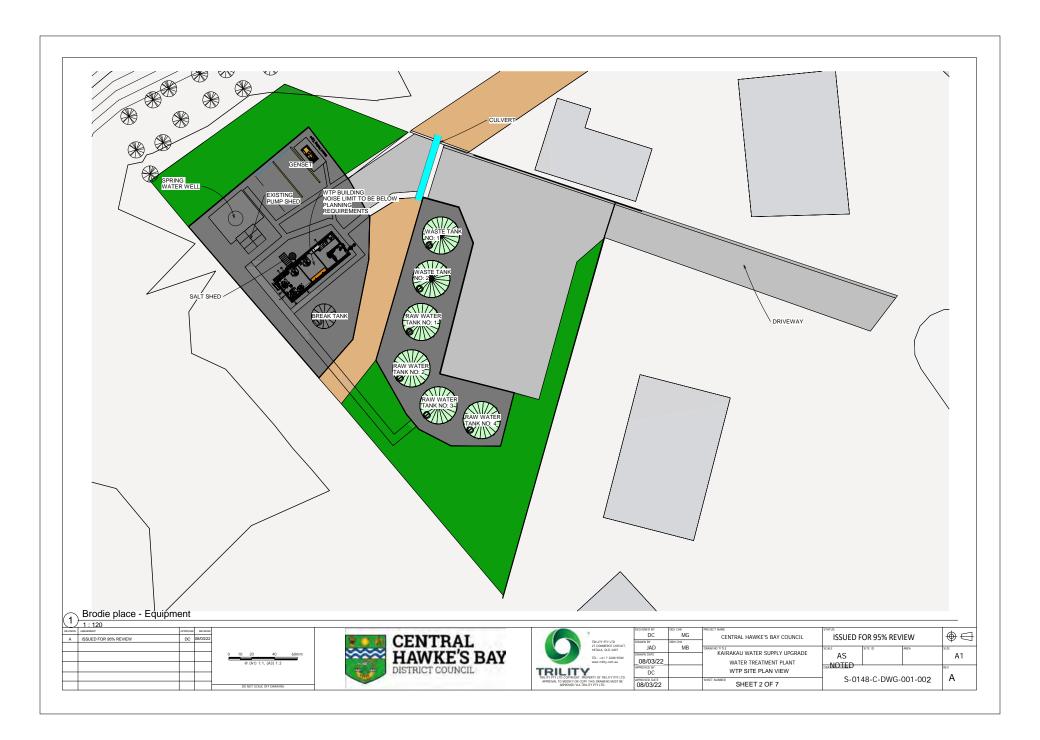

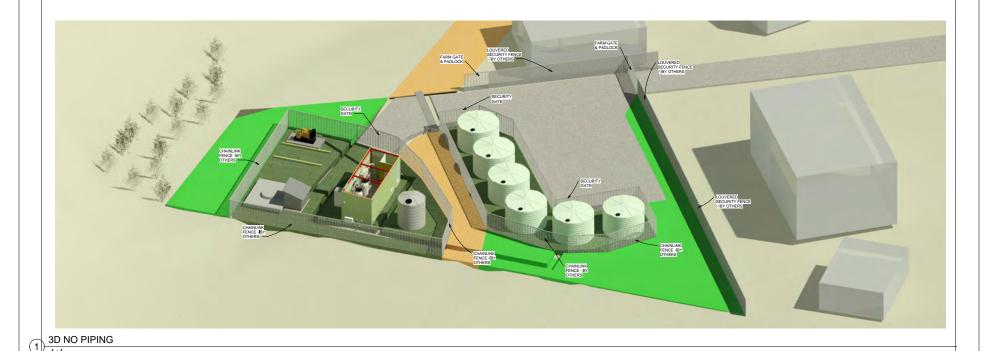

CENTRAL HAWKE'S BAY DISTRICT COUNCIL $\oplus \Box$

Α1

ISSUED FOR 95% REVIEW

S-0148-C-DWG-001-004

AS

NOTED

CENTRAL HAWKE'S BAY COUNCIL

KAIRAKAU WATER SUPPLY UPGRADE

WATER TREATMENT PLANT WTP SITE ISOMETRIC VIEW

SHEET 4 OF 7


JAD


08/03/22


DC BY


08/03/22

MB

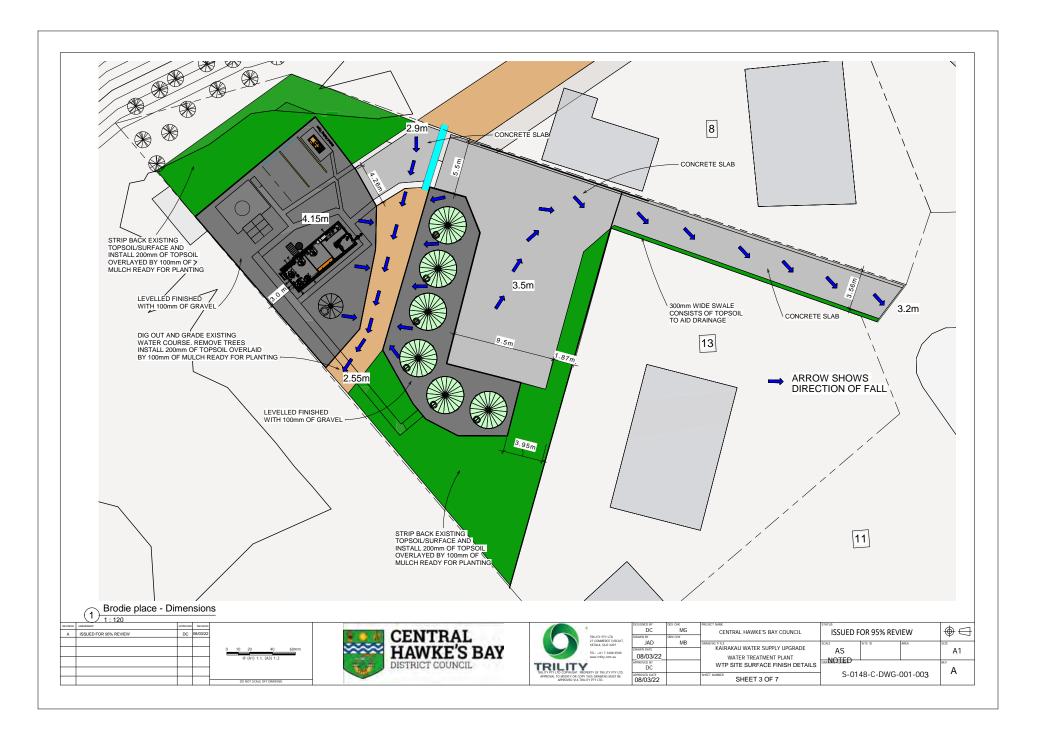

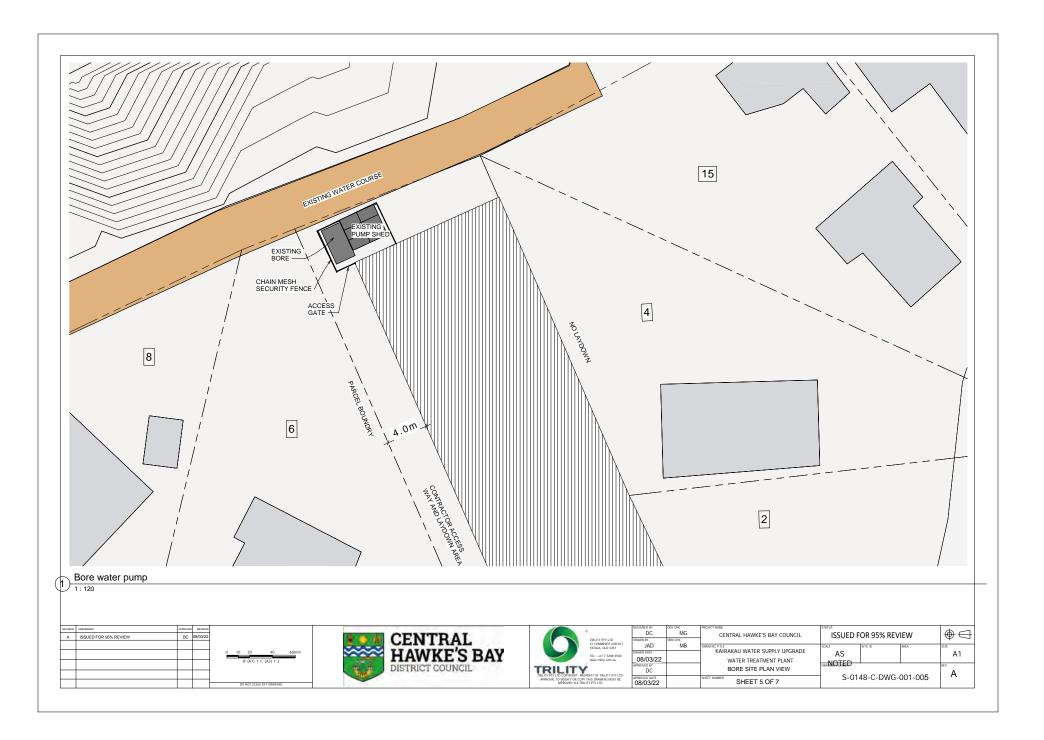

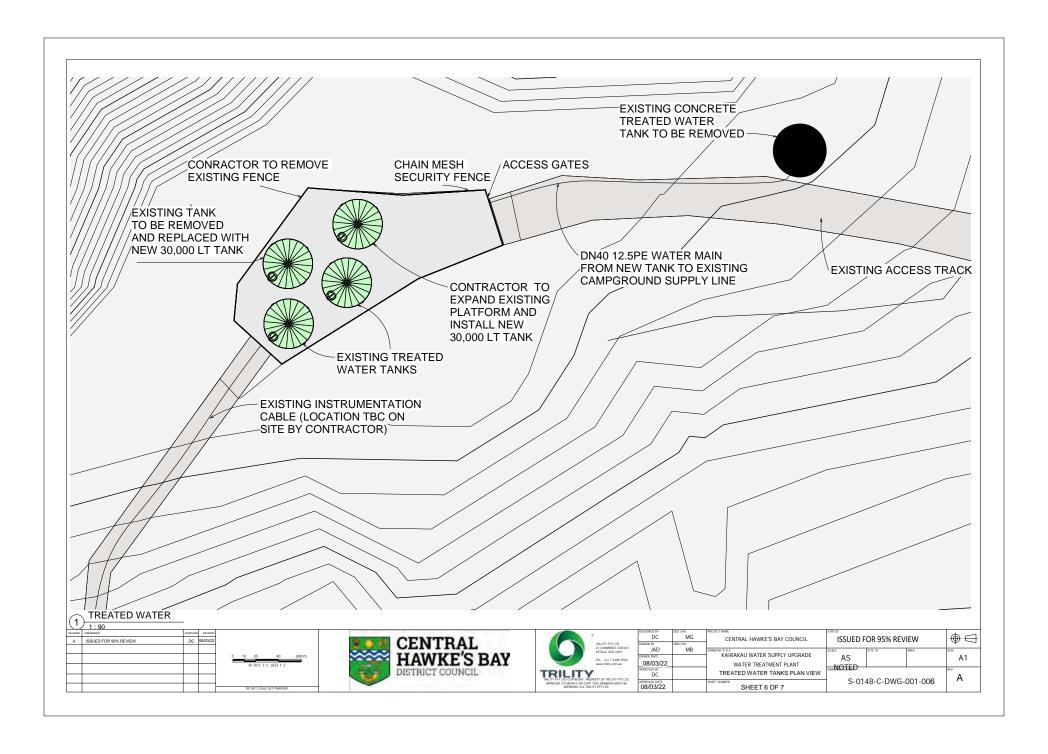

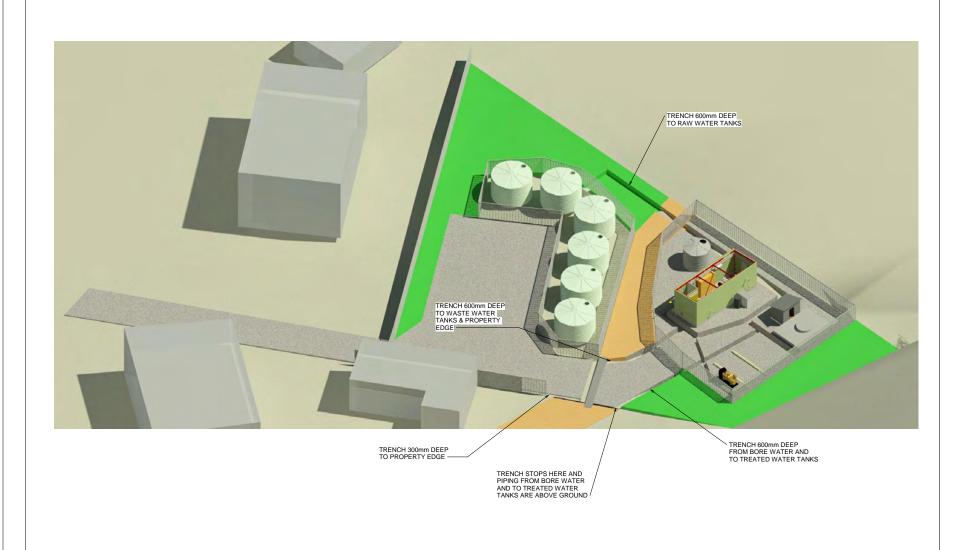

| REVISION | AMENDMENT | APPROVE | REVISION |
|-------------------------|-----------|---------|----------|
| A ISSUED FOR 95% REVIEW | | DC | 08/03/22 |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |





| | TRILITY PTY LTD |
|--|--|
| | 27 COMMERCE CIRCUIT, YATALA, QLD 4207 |
| | TEL: +61 7 3208 9500 www.trility.com.au |
| TRILITY TRILITY PTY LTD COPYRIGHT, PR | OPERTY OF TRILITY PTY LTD. |
| APPROVAL TO MODIFY OR COF APPROVED VIA TR | |

| | | | | | | | | ı |
|-----|--------------------------------|---------------|---|----------------------|---------|------|-----|---|
| | DC DRAWN BY | MG DRN CHK | CENTRAL HAWKE'S BAY COUNCIL | ISSUED F | 'IEW | ⊕ 🖯 | | |
| | JAD DRAWN DATE 08/03/22 | MB | KAIRAKAU WATER SUPPLY UPGRADE WATER TREATMENT PLANT | AS | SITE ID | AREA | A1 | |
| , [| APPROVED BY DC APPROVED DATE | | TRENCHING LAYOUT | S-0148-C-DWG-001-007 | | | A A | |
| | 08/03/22 | | SHEET 7 OF 7 | | | | | l |